

**NOTES:**  
 1. STUB WATER WITH CURB STOP AND WASTEWATER 6- FEET MINIMUM BEHIND EDGE OF JOINT TRENCH; 15- FEET MINIMUM FROM PROPERTY LINE AND NOT UNDER DRIVEWAY. KEEP 3- FEET SEPARATION FROM WATER AND WASTEWATER TO GAS SERVICE.  
 2. GAS AND ELECTRIC SERVICES SHALL GENERALLY BE ON THE TOPOGRAPHIC HIGH SIDE OF THE LOT; WATER AND WASTEWATER SHALL GENERALLY BE ON THE TOPOGRAPHIC LOW SIDE OF THE LOT.

LINE LEGEND		
UTILITY	SYMBOL	DEPTH TO TOP OF PIPE
TELECOMMUNICATIONS	UFO	MIN. 30"
GAS	GAS	MIN. 30"
UNDERGROUND ELECTRIC/ ELECTRIC SERVICE	ES UGE ES	MIN. 44"
WATER	W	MIN. 60"
WASTEWATER	SS	MIN. 60"
STORM SEWER/STRUCTURES	STRM	PER DCM


User: KOTTWAN, Mar 04, 2021, 8:08am Drawing: P:\LCP GROUP DOCUMENTS\CAD RESOURCES\STANDARD DETAILS\CURRENT CITY STANDARD DETAILS\SIDWALK STREET SECTIONS.dwg - Layout: P-2A



RESIDENTIAL, LOCAL  
DETACHED SIDEWALK  
PLAN VIEW



APPROVED:  
*Gayle Sturdivant*  
 CITY ENGINEER  
 ISSUED: 3/4/21 REVISED: DRAWING NO. D-2A

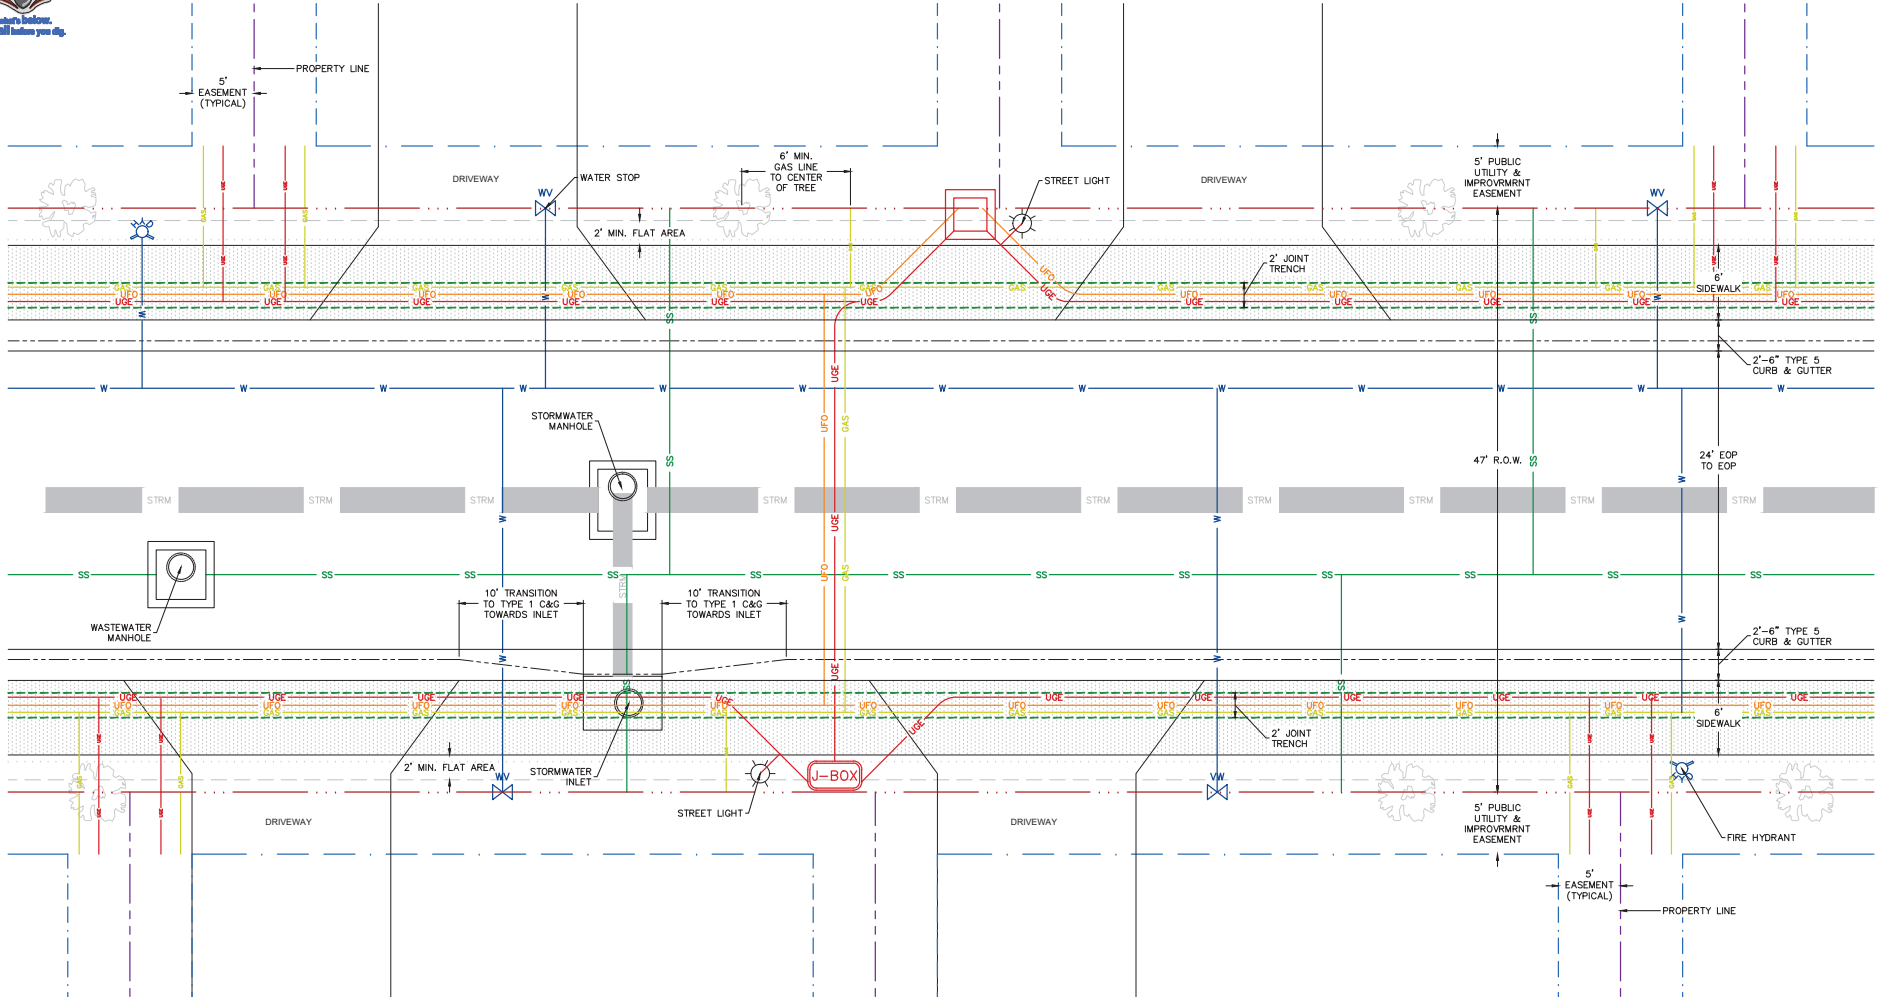

- NOTES:**
1. STUB WATER WITH CURB STOP AND WASTEWATER 6- FEET MINIMUM BEHIND EDGE OF JOINT TRENCH; 15- FEET MINIMUM FROM PROPERTY LINE AND NOT UNDER DRIVEWAY; KEEP 3- FEET SEPARATION FROM WATER AND WASTEWATER TO GAS SERVICE.
  2. GAS AND ELECTRIC SERVICES SHALL GENERALLY BE ON THE TOPOGRAPHIC HIGH SIDE OF THE LOT; WATER AND WASTEWATER SHALL GENERALLY BE ON THE TOPOGRAPHIC LOW SIDE OF THE LOT.

LINE LEGEND		
UTILITY	SYMBOL	DEPTH TO TOP OF PIPE
TELECOMMUNICATIONS	UFO	MIN. 30"
GAS	GAS	MIN. 30"
UNDERGROUND ELECTRIC/ ELECTRIC SERVICE	ES UGE ES	MIN. 44"
WATER	W	MIN. 60"
WASTEWATER	SS	MIN. 60"
STORM SEWER/STRUCTURES	STRM	PER DCM

User: KOTIYAN, Mar 04, 2021, 8:11am Drawing: P:\CIP GROUP DOCUMENTS\CAD RESOURCES\STANDARD DETAILS\CURRENT CITY STANDARD DETAILS\STANDARD STREET SECTIONS.dwg - Layout: P-2B



MINOR RESIDENTIAL  
(LOCAL) (<21 LOTS)  
ATTACHED SIDEWALKS  
PLAN VIEW



APPROVED:  
*Gayle Sturdivant*  
CITY ENGINEER  
ISSUED: 3/4/21 REVISIONS: DRAWING NO. D-2B